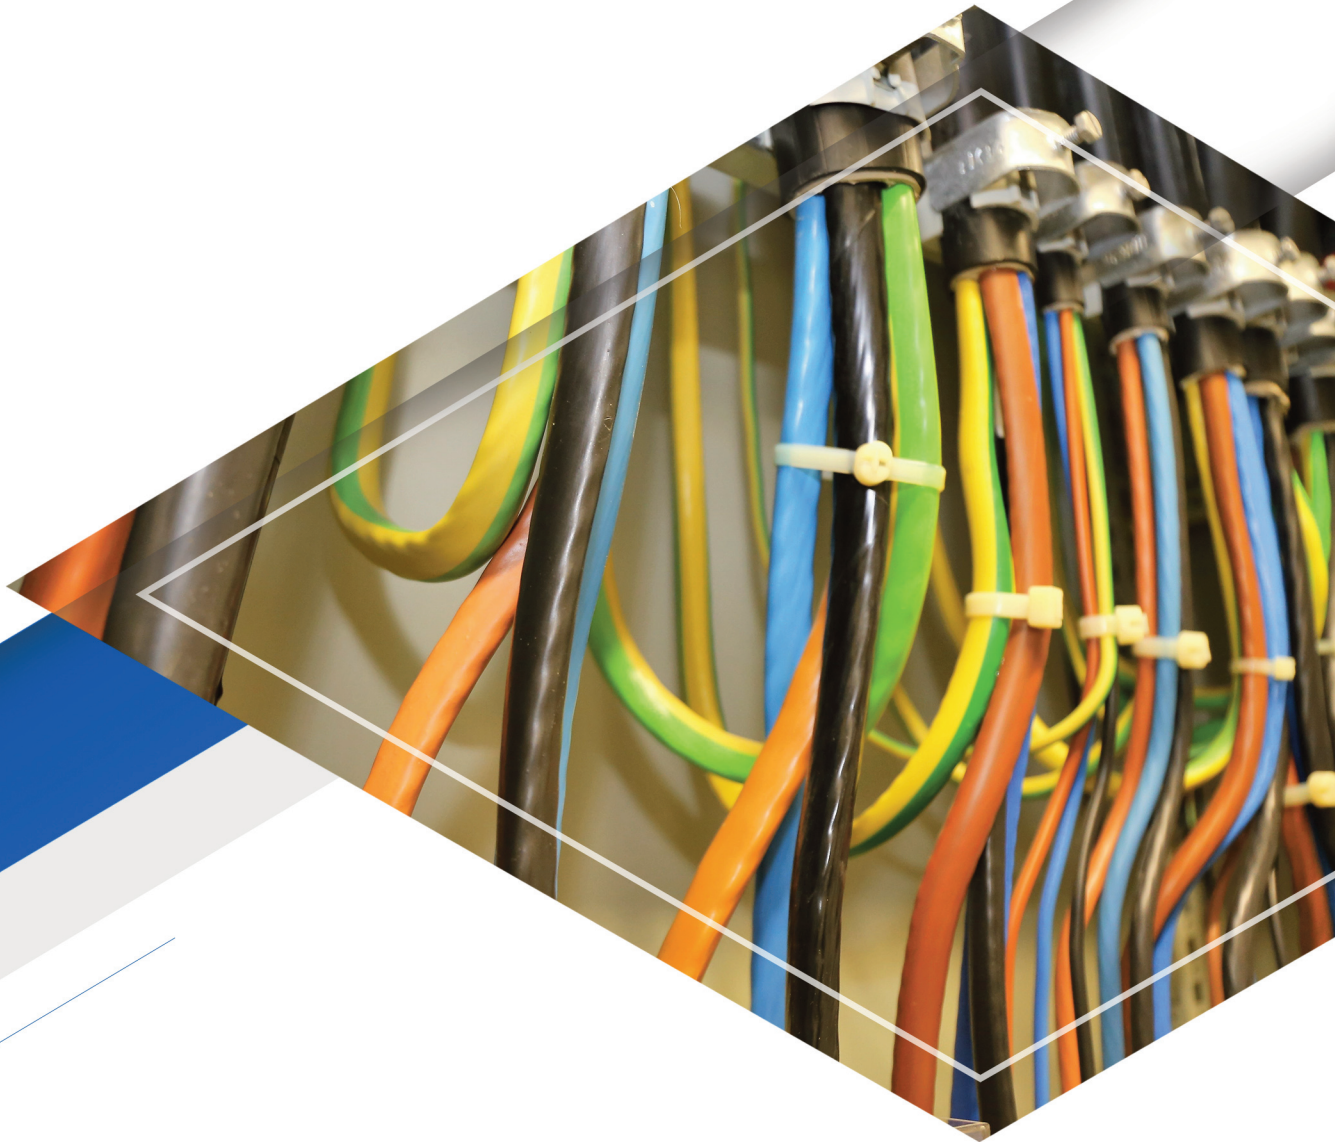


www.eupen.com

# Technical Data for Low Voltage

Power and Control cables



Kabelwerk  
**EUPEN** AG





## Contents

|   |    |
|---|----|
| Scope .....   | 7  |
| 1. Conductors .....   | 7  |
| 1.1 Conductors class 1 acc. to IEC 60228 .....  | 8  |
| 1.2 Conductors class 2 acc. to IEC 60228 .....  | 8  |
| 1.3 Conductors class 5 acc. to IEC 60228 .....  | 9  |
| 1.4 Resistance conversion at a temperature other than 20 °C .....   | 9  |
| 2. Insulation .....   | 10 |
| 2.1 Standard types.....   | 10 |
| 2.2 Fire resistant types .....  | 10 |
| 3. Choice of cross-section.....   | 11 |
| 3.1 Thermic effect .....  | 11 |
| 3.2 Voltage drop $\Delta U$ .....   | 11 |
| 4. Current ratings.....   | 12 |
| 4.1 Generally .....   | 12 |
| 4.2 Non exhaustive methods of installation acc. to IEC 60364-5-52 .....   | 12 |
| 4.2.1 Installation reference methods forming basis of tabulated current-carrying capacities acc. to IEC 60364-5-52 table A.52.3 and B.52.1 .....  | 14 |
| 4.2.2 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – PVC or XLPE insulation, two loaded conductors, copper or aluminium .....  | 16 |
| 4.2.3 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – PVC or XLPE insulation, three loaded conductors, copper or aluminium..... | 17 |
| 4.2.4 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – PVC insulation, copper or aluminium conductors.....                       | 18 |
| 4.2.5 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – XLPE insulation, copper or aluminium conductors .....                     | 19 |
| 4.3 Correction factors for specific installation conditions .....   | 20 |
| 4.3.1 Correction factors for ambient air temperature other than 30 °C (IEC table B.52.14).....  | 20 |
| 4.3.2 Correction factors for ambient ground temperature other than 20 °C (IEC table B.52.15).....   | 20 |
| 4.3.3 Correction factors for soil thermal resistivity other than 2,5 K·m/W (IEC table B.52.16).....   | 21 |
| 4.4 Reduction factors .....   | 21 |
| 4.4.1 Reduction factors for more than one multi-core cable or system of single-core cables laid according to method C (IEC table B.52.17 item 2).....                                       | 21 |
| 4.4.2 Reduction factors for more than one multi-core cable laid according to method E (IEC table B.52.20).....  | 21 |





|        |  |    |
|--------|--|----|
| 4.4.3  | Reduction factors for groups of one or more circuits of single-core cable laid according to method F (IEC table B.52.21).....                    | 23 |
| 4.4.4  | Reduction factors for groups of one or more circuits of single-core cable laid according to method G .....                                       | 24 |
| 4.4.5  | Reduction factors for more than one multi-core cable or system of single-core cables laid according to method B1 (IEC table B.52.17 item 1)..... | 24 |
| 4.4.6  | Reduction factors for more than one circuit of cables laid in ducts in the ground according to method D1 (IEC table B.52.19 A).....              | 25 |
| 4.4.7  | Reduction factors for more than one circuit of cables laid in ducts in the ground according to method D1 (IEC table B.52.19 B).....              | 26 |
| 4.4.8  | Reduction factors for more than one circuit of cables laid directly in the ground according to method D2 (IEC table B.52.18).....                | 27 |
| 4.4.9  | Reduction factors for single core cables with Al-armour .....  | 27 |
| 4.4.10 | Derating factors for control cables with > 3 cores on load .....   | 27 |
| 5.     | Thermic short circuit current rating .....   | 28 |
| 6.     | Admissible pulling forces P(N).....  | 30 |
| 7.     | Disclaimer .....   | 30 |



# Technical Data for Low Voltage Power and Control cables 0,6/1 kV

## Scope









This document contains the general technical properties of our low voltage power cables according to IEC 60502-1.

Individual properties like rated voltage, cable code denomination, colour code of cores and outer sheaths, marking on cables etc. are given in specific type documentation respectively in the specific project documentation.

## 1. Conductors

The conductors of our cables, copper (Cu) or aluminium (Al), are in accordance with the requirements of the IEC 60228.

A distinction is made between the following conductor structures:

| Conductor material | Class 1   |   | Class 2   |   | Class 5   |
|--------------------|---|---|---|---|---|
|                    | circular solid  | sector shaped solid   | circular stranded <sup>[#]</sup>  | sector shaped stranded  | flexible  |
| Cu <sup>(*)</sup>  |  | *****   |  |  |  |
| Al                 |  |  |  |  | *****   |

<sup>(\*)</sup> bare or tinned.

<sup>[#]</sup> compacted for cross-sections  $\geq 6 \text{ mm}^2$



For the construction details and the conductor resistance limits see following tables:

### 1.1 Conductors class 1 acc. to IEC 60228

| Nominal cross-sectional area of conductor<br>mm <sup>2</sup> | Max. DC conductor resistance at 20 °C |                |            |
|--|---------------------------------------|----------------|------------|
|  | Cu                                    |                | Al<br>Ω/km |
|  | bare<br>Ω/km                          | tinned<br>Ω/km |            |
| 1,5  | 12,1                                  | 12,2           | -          |
| 2,5  | 7,41                                  | 7,56           | -          |
| 4  | 4,61                                  | 4,70           | -          |
| 6  | 3,08                                  | 3,11           | -          |
| 10   | 1,83                                  | 1,84           | -          |
| 16   | 1,15                                  | 1,16           | 1,91       |
| 25   | -                                     | -              | 1,20       |
| 35   | -                                     | -              | 0,868      |
| 50   | -                                     | -              | 0,641      |
| 70   | -                                     | -              | 0,443      |
| 95   | -                                     | -              | 0,320      |
| 120  | -                                     | -              | 0,253      |
| 150  | -                                     | -              | 0,206      |
| 185  | -                                     | -              | 0,164      |
| 240  | -                                     | -              | 0,125      |
| 300  | -                                     | -              | 0,100      |
| 400  | -                                     | -              | 0,0778     |

### 1.2 Conductors class 2 acc. to IEC 60228

| Nominal cross-sectional area of conductor<br>mm <sup>2</sup> | Minimum number of wires |                             |               |                             |               | Max. DC conductor resistance at 20 °C |                |            |
|--|-------------------------|-----------------------------|---------------|-----------------------------|---------------|---------------------------------------|----------------|------------|
|  | Cu                      |                             |               | Al                          |               | Cu                                    |                | Al<br>Ω/km |
|  | circular stranded       | circular stranded compacted | sector shaped | circular stranded compacted | sector shaped | bare<br>Ω/km                          | tinned<br>Ω/km |            |
| 1,5  | 7                       | -                           | -             | -                           | -             | 12,1                                  | 12,2           | -          |
| 2,5  | 7                       | -                           | -             | -                           | -             | 7,41                                  | 7,56           | -          |
| 4  | 7                       | -                           | -             | -                           | -             | 4,61                                  | 4,70           | -          |
| 6  | 7                       | 6                           | -             | -                           | -             | 3,08                                  | 3,11           | -          |
| 10   | 7                       | 6                           | -             | -                           | -             | 1,83                                  | 1,84           | -          |
| 16   | 7                       | 6                           | -             | 6                           | -             | 1,15                                  | 1,16           | 1,91       |
| 25   | 7                       | 6                           | -             | 6                           | -             | 0,727                                 | 0,734          | 1,20       |
| 35   | 7                       | 6                           | -             | 6                           | -             | 0,524                                 | 0,529          | 0,868      |
| 50   | 19                      | 6                           | 6             | 6                           | 6             | 0,387                                 | 0,391          | 0,641      |
| 70   | 19                      | 12                          | 12            | 12                          | 12            | 0,268                                 | 0,270          | 0,443      |
| 95   | 19                      | 15                          | 15            | 15                          | 15            | 0,193                                 | 0,195          | 0,320      |
| 120  | 37                      | 18                          | 18            | 15                          | 15            | 0,153                                 | 0,154          | 0,253      |
| 150  | 37                      | 18                          | 18            | 15                          | 15            | 0,124                                 | 0,126          | 0,206      |
| 185  | 37                      | 30                          | 30            | 30                          | 30            | 0,0991                                | 0,100          | 0,164      |
| 240  | 61                      | 34                          | 34            | 30                          | 30            | 0,0754                                | 0,0762         | 0,125      |
| 300  | 61                      | 34                          | 34            | 30                          | 30            | 0,0601                                | 0,0607         | 0,100      |
| 400  | 61                      | 53                          | 53            | 53                          | 53            | 0,0470                                | 0,0475         | 0,0778     |
| 500  | 61                      | 53                          | 53            | 53                          | 53            | 0,0366                                | 0,0369         | 0,0605     |
| 630  | 91                      | 53                          | 53            | 53                          | 53            | 0,0283                                | 0,0286         | 0,0469     |



### 1.3 Conductors class 5 acc. to IEC 60228

| Nominal cross-sectional area of conductor<br><br>mm <sup>2</sup> | Max. wire-∅<br><br>mm | Max. DC conductor resistance at 20 °C |                    |
|--|-----------------------|---------------------------------------|--------------------|
|  |                       | Cu                                    |                    |
|  |                       | bare<br><br>Ω/km                      | tinned<br><br>Ω/km |
| 1,5  | 0,26                  | 13,3                                  | 13,7               |
| 2,5  | 0,26                  | 7,98                                  | 8,21               |
| 4  | 0,31                  | 4,95                                  | 5,09               |
| 6  | 0,31                  | 3,30                                  | 3,39               |
| 10   | 0,41                  | 1,91                                  | 1,95               |
| 16   | 0,41                  | 1,21                                  | 1,24               |
| 25   | 0,41                  | 0,78                                  | 0,795              |
| 35   | 0,41                  | 0,554                                 | 0,565              |
| 50   | 0,41                  | 0,386                                 | 0,393              |
| 70   | 0,51                  | 0,272                                 | 0,277              |
| 95   | 0,51                  | 0,206                                 | 0,210              |
| 120  | 0,51                  | 0,161                                 | 0,164              |
| 150  | 0,51                  | 0,129                                 | 0,132              |
| 185  | 0,51                  | 0,106                                 | 0,108              |
| 240  | 0,51                  | 0,0801                                | 0,0817             |
| 300  | 0,51                  | 0,0641                                | 0,0654             |
| 400  | 0,51                  | 0,0486                                | 0,0495             |

On demand, for special applications, we can offer conductors class 6 with thinner wires as class 5.

### 1.4 Resistance conversion at a temperature other than 20 °C

For conductor temperatures other than 20 °C the DC resistance shall be calculated with the following formula:

$$R_x = R_0 [1 + a (T_x - 20)] \Omega/\text{km}$$

$R_x$  = DC resistance at the temperature  $T_x$  (Ω/km)

$R_0$  = DC resistance at 20 °C (Ω/km)

$T_x$  = conductor temperature (°C)

$a$  = linear resistance temperature coefficient: 0,00393 for copper (K<sup>-1</sup>)  
0,00403 for aluminium (K<sup>-1</sup>)

**Note:** If the AC resistance is needed, the skin effect factor  $\gamma_s$  and the proximity effect factor  $\gamma_p$  shall be taken into account. We advise to consult the IEC 60287-1-1 for the applicable formulas.



## 2. Insulation

### 2.1 Standard types

Our cables can be insulated with the following compound types from the IEC 60502-1 standard

- a) Thermoplastic: PVC type A
- b) Cross-linked: XLPE

The current transmission limits of a cable depend on the thermal limits of the conductor insulation during operating and during short circuit.

The best cost/performance ratio has the XLPE compound. That's why the majority of our LV power cables are XLPE insulated types.

Temperature range for different insulation types see following table

| Type  | Max. conductor temperature |  |
|-------|----------------------------|--|
|       | operating                  | short-circuit  |
| PVC/A | 70 °C                      | ≤ 300 mm <sup>2</sup> : 160 °C<br>> 300 mm <sup>2</sup> : 140 °C |
| XLPE  | 90 °C                      | 250 °C   |

### 2.2 Fire resistant types

For fire resistant applications we can offer the following solution for our LV Power cables

Combination of MICA tapes applied directly over the conductor + XLPE insulation

Specific fire resistance performance: see specific type documentation respectively the specific project documentation.

### 3. Choice of cross-section

The two following criteria must be considered for the determination of the correct cross-section.

- 1) The thermic effect caused by the warming of the conductor due to the transmitted current.
- 2) The voltage drop caused by the electrical resistance of the conductor in combination with the transmitted current and the network configuration (DC or AC network).

#### 3.1 Thermic effect

The thermic effect has been taken into consideration in the current carrying tables. By correct use of these tables, including the applicable correcting factors, the chosen cross-section is sufficient to limit the thermic effect within the permissible values.

#### 3.2 Voltage drop $\Delta U$

The admissible voltage drop  $\Delta U$  depends on the applicable regulations of each network. The voltage drop should not exceed 5% of the nominal voltage. It is nevertheless the responsibility of the engineering to determinate the applicable voltage drop voltage for each specific network.

The voltage drop  $\Delta U$  for each network configuration can be calculated with the following formula:

##### Direct current (DC) network

$$\Delta U = 2 \cdot l \cdot R \cdot I$$

##### Single phase AC network

$$\Delta U = 2 \cdot l \cdot (R \cdot \cos \varphi + \omega L \cdot \sin \varphi) \cdot I$$

##### Three phase AC network

$$\Delta U = \sqrt{3} \cdot l \cdot (R \cdot \cos \varphi + \omega L \cdot \sin \varphi) \cdot I$$

- $\Delta U$ : voltage drop (V)  
 $R$ : conductor resistance at  $t_{\max}$  ( $\Omega/\text{km}$ )  
 $\omega L$ : inductive resistance ( $\Omega/\text{km}$ )<sup>(\*)</sup>  
 $\varphi$ : phase shift  
 $l$ : cable length (km)  
 $I$ : current intensity (A)

(\*) The inductive resistance of a cable depends on many factors like number and dimension of cores, presence of a magnetic armour or not, configuration in case of single-core types...  
For specific projects we can provide the values of the inductive resistance on demand.



## 4. Current ratings

### 4.1 Generally

The following information is based on the standard IEC 60364-5-52 and does not claim to be complete. In case of doubt, the above mentioned IEC standard shall be consulted.

The current ratings in this document are based on the following conditions:

- Max. conductor temperature: PVC: 70 °C  
XLPE: 90 °C
- Ambient temperature (air): 30 °C
- Ground temperature: 20 °C
- Laying depth: 0,7 m
- Thermal resistivity of the soil: 2,5 K·m/W

For deviating conditions, correction factors must be applied.

These current ratings may also be applied for armoured multi-core cables, but not for armoured single-core cables.

### 4.2 Non exhaustive methods of installation acc. to IEC 60364-5-52

The current-carrying capacities tabulated in this document for cables laid in the ground are intended to relate only to runs in and around buildings. For other applications, for example public networks, appropriate calculations must be made.

The reference methods are those methods of installation for which the current-carrying capacity has been determined by test or calculation.

#### a) Reference methods **B1**:

Conduit mounted so that the gap between the conduit and the surface is less than 0,3 times the conduit diameter. The conduit can be metal or plastic. Where the conduit is fixed to a masonry wall the current-carrying capacity of the cable or insulated conductors may be higher.

#### b) Reference method **C**:

Cable mounted so that the gap between the cable and the surface is less than 0,3 times the cable diameter. Where the cable is fixed to or embedded in a masonry wall the current-carrying capacity may be higher.

Note 1 The term "masonry" is taken to include brickwork, concrete, plaster and the like (other than thermally insulation materials).

#### c) Reference method **D1** and **D2**:

Cables drawn into 100 mm diameter plastic, earthenware or metallic ducts laid in direct contact with soil having a thermal resistivity of 2,5 K·m/W and a depth of 0,7 m.

Cables laid in direct contact with soil having thermal resistivity of 2,5 K·m/W and a depth of 0,7 m.

Note 2 With cables laid in the ground it is important to limit the temperature of the sheath. If the heat of the sheath dries out the soil, thermal resistivity may increase and the cable becomes overloaded. One way of avoiding this heating is to use the tables for 70 °C conductor temperature even for cables designed for 90 °C.









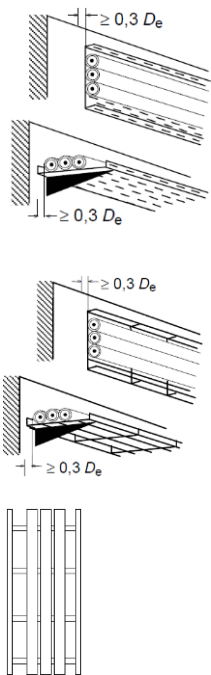
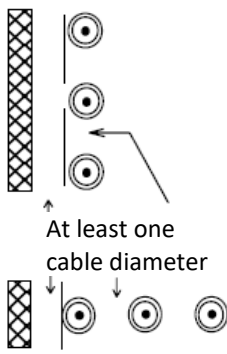
d) Reference methods E, F and G:

A cable so supported that the total heat dissipation is not impeded. Heating due to solar radiation and other sources shall be taken into account. Care shall be taken that natural air convection is not impeded. In practice, a clearance between a cable and any adjacent surface of at least 0,3 times the cable external diameter for multi-core cables or 1 time the cable diameter for single-core cables is sufficient to permit the use of current-carrying capacities appropriate to free air conditions.

For details (e.g. distances, footnotes...) applicable on the specific installation methods see the IEC 60364-5-52.

4.2.1 Installation reference methods forming basis of tabulated current-carrying capacities acc. to IEC 60364-5-52 table A.52.3 and B.52.1

| Table  | Item No.  | Reference method of installation  | Current-carrying capacities for single circuits |                               |    |   |
|--------|-----------|---|---|-------------------------------|----|---|
|        |           |   | Thermoplastic insulation PVC                    | Thermosetting insulation XLPE |    |   |
| A.52.3 | 56        |  <p>Sheathed single-core or multi-core cable in an open or ventilated cable channel run horizontally or vertically<sup>n</sup></p> | B1  |                               |    |   |
| A.52.3 | 30        |  <p>Single-core or multi-core cables: on unperforated tray run horizontally or vertically<sup>c,h</sup></p>                        |   |                               | C  |   |
| A.52.3 | 70 and 71 |  <p>Multi-core cable in conduit or in cable ducting in the ground</p>   |   |                               | D1 | <p>two loaded conductors see 4.2.2</p> <p>three loaded conductors see 4.2.3</p> |
|        |           |  <p>Single-core cable in conduit or in cable ducting in the ground</p>   |   |                               |    |   |
| A.52.3 | 72 and 73 |  <p>Sheathed single-core or multi-core cables direct in the ground - without added mechanical protection<sup>q</sup></p>         | D2  |                               |    |   |
|        |           |  <p>Sheathed single-core or multi-core cables direct in the ground - with added mechanical protection<sup>q</sup></p>            |   |                               |    |   |

| Table  | Item No.      | Reference method of installation  | Current-carrying capacities for single circuits |           |                               |   |
|--------|---------------|---|---|-----------|-------------------------------|---|
|        |               |   | Thermoplastic insulation PVC                    |           | Thermosetting insulation XLPE |   |
|        |               |   | Number of cores                                 |           |                               |   |
|        |               |   | 2   | 3         | 2                             | 3 |
| A.52.3 | 31, 32 and 34 |  <p>Single-core or multi-core cables:<br/>On perforated tray run horizontally or vertically<sup>c,h</sup></p> <p>Single-core or multi-core cables:<br/>On brackets or on a wire mesh tray run horizontally or vertically<sup>c,h</sup></p> <p>Single-core or multi-core cables:<br/>On ladder<sup>c</sup></p> | E<br>or<br>F                                    | see 4.2.4 | see 4.2.5                     |   |
| B.52.1 | NA            |  <p>Single-core cables, spaced in free air</p>   | G   |           |                               |   |

<sup>c</sup> Care shall be taken where the cable runs vertically and ventilation is restricted. The ambient temperature at the top of the vertical section can be increased considerably. The matter is under consideration.

<sup>h</sup>  $D_e$  is the external diameter of a multi-core cable:

- $2,2 \times$  the cable diameter when three single-core cables are bound in trefoil, or
- $3 \times$  the cable diameter when three single-core cables are laid in flat formation.

<sup>n</sup> It is recommended that these methods of installation are used only in areas where access is restricted to authorized persons so that the reduction in current-carrying capacity and the fire hazard due to the accumulation of debris can be prevented.

<sup>q</sup> The inclusion of directly buried cables in this item is satisfactory when the soil thermal resistivity is of the order of  $2,5 \text{ K}\cdot\text{m}/\text{W}$ . For lower soil resistivities, the current-carrying capacity for directly buried cables is appreciably higher than for cables in ducts.



4.2.2 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – PVC or XLPE insulation, two loaded conductors, copper or aluminium

| Nominal cross-sectional area of conductor<br><br>mm <sup>2</sup> | Current-carrying capacity |      |      |      |      |      |     |      |     |      |
|--|---------------------------|------|------|------|------|------|-----|------|-----|------|
|  | A                         |      |      |      |      |      |     |      |     |      |
|  | B1                        |      | B2   |      | C    |      | D1  |      | D2  |      |
|  | PVC                       | XLPE | PVC  | XLPE | PVC  | XLPE | PVC | XLPE | PVC | XLPE |
| <b>Cu</b>  |                           |      |      |      |      |      |     |      |     |      |
| 1,5  | 17,5                      | 23   | 16,5 | 22   | 19,5 | 24   | 22  | 25   | 22  | 27   |
| 2,5  | 24                        | 31   | 23   | 30   | 27   | 33   | 29  | 33   | 28  | 35   |
| 4  | 32                        | 42   | 30   | 40   | 36   | 45   | 37  | 43   | 38  | 46   |
| 6  | 41                        | 54   | 38   | 51   | 46   | 58   | 46  | 53   | 48  | 58   |
| 10   | 57                        | 75   | 52   | 69   | 63   | 80   | 60  | 71   | 64  | 77   |
| 16   | 76                        | 100  | 69   | 91   | 85   | 107  | 78  | 91   | 83  | 100  |
| 25   | 101                       | 133  | 90   | 119  | 112  | 138  | 99  | 116  | 110 | 129  |
| 35   | 125                       | 164  | 111  | 146  | 138  | 171  | 119 | 139  | 132 | 155  |
| 50   | 151                       | 198  | 133  | 175  | 168  | 209  | 140 | 164  | 156 | 183  |
| 70   | 192                       | 253  | 168  | 221  | 213  | 269  | 173 | 203  | 192 | 225  |
| 95   | 232                       | 306  | 201  | 265  | 258  | 328  | 204 | 239  | 230 | 270  |
| 120  | 269                       | 354  | 232  | 305  | 299  | 382  | 231 | 271  | 261 | 306  |
| 150  | 300                       | 393  | 258  | 334  | 344  | 441  | 261 | 306  | 293 | 343  |
| 185  | 341                       | 449  | 294  | 384  | 392  | 506  | 292 | 343  | 331 | 387  |
| 240  | 400                       | 528  | 344  | 459  | 461  | 599  | 336 | 395  | 382 | 448  |
| 300  | 458                       | 603  | 394  | 532  | 530  | 693  | 379 | 446  | 427 | 502  |
| <b>Al</b>  |                           |      |      |      |      |      |     |      |     |      |
| 16   | 60                        | 79   | 54   | 72   | 66   | 84   | 61  | 71   | 63  | 76   |
| 25   | 79                        | 105  | 71   | 94   | 83   | 101  | 77  | 90   | 82  | 98   |
| 35   | 97                        | 130  | 86   | 115  | 103  | 126  | 93  | 108  | 98  | 117  |
| 50   | 118                       | 157  | 104  | 138  | 125  | 154  | 109 | 128  | 117 | 139  |
| 70   | 150                       | 200  | 131  | 175  | 160  | 198  | 135 | 158  | 145 | 170  |
| 95   | 181                       | 242  | 157  | 210  | 195  | 241  | 159 | 186  | 173 | 204  |
| 120  | 210                       | 281  | 181  | 242  | 226  | 280  | 180 | 211  | 200 | 233  |
| 150  | 234                       | 307  | 201  | 261  | 261  | 324  | 204 | 238  | 224 | 261  |
| 185  | 266                       | 351  | 230  | 300  | 298  | 371  | 228 | 267  | 255 | 296  |
| 240  | 312                       | 412  | 269  | 358  | 352  | 439  | 262 | 307  | 298 | 343  |
| 300  | 358                       | 471  | 308  | 415  | 406  | 508  | 296 | 346  | 336 | 386  |



4.2.3 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – PVC or XLPE insulation, three loaded conductors, copper or aluminium

| Nominal cross-sectional area of conductor<br><br>mm <sup>2</sup> | Current-carrying capacity<br>A |      |     |      |      |      |     |      |     |      |
|--|--------------------------------|------|-----|------|------|------|-----|------|-----|------|
|  | B1                             |      | B2  |      | C    |      | D1  |      | D2  |      |
|  | PVC                            | XLPE | PVC | XLPE | PVC  | XLPE | PVC | XLPE | PVC | XLPE |
| <b>Cu</b>  |                                |      |     |      |      |      |     |      |     |      |
| 1,5  | 15,5                           | 20   | 15  | 19,5 | 17,5 | 22   | 18  | 21   | 19  | 23   |
| 2,5  | 21                             | 28   | 20  | 26   | 24   | 30   | 24  | 28   | 24  | 30   |
| 4  | 28                             | 37   | 27  | 35   | 32   | 40   | 30  | 36   | 33  | 39   |
| 6  | 36                             | 48   | 34  | 44   | 41   | 52   | 38  | 44   | 41  | 49   |
| 10   | 50                             | 66   | 46  | 60   | 57   | 71   | 50  | 58   | 54  | 65   |
| 16   | 68                             | 88   | 62  | 80   | 76   | 96   | 64  | 75   | 70  | 84   |
| 25   | 89                             | 117  | 80  | 105  | 96   | 119  | 82  | 96   | 92  | 107  |
| 35   | 110                            | 144  | 99  | 128  | 119  | 147  | 98  | 115  | 110 | 129  |
| 50   | 134                            | 175  | 118 | 154  | 144  | 179  | 116 | 135  | 130 | 153  |
| 70   | 171                            | 222  | 149 | 194  | 184  | 229  | 143 | 167  | 162 | 188  |
| 95   | 207                            | 269  | 179 | 233  | 223  | 278  | 169 | 197  | 193 | 226  |
| 120  | 239                            | 312  | 206 | 268  | 259  | 322  | 192 | 223  | 220 | 257  |
| 150  | 262                            | 342  | 225 | 300  | 299  | 371  | 217 | 251  | 246 | 287  |
| 185  | 296                            | 384  | 255 | 340  | 341  | 424  | 243 | 281  | 278 | 324  |
| 240  | 346                            | 450  | 297 | 398  | 403  | 500  | 280 | 324  | 320 | 375  |
| 300  | 394                            | 514  | 339 | 455  | 464  | 576  | 316 | 365  | 359 | 419  |
| <b>Al</b>  |                                |      |     |      |      |      |     |      |     |      |
| 16   | 53                             | 71   | 48  | 64   | 59   | 76   | 50  | 59   | 53  | 64   |
| 25   | 70                             | 93   | 62  | 84   | 73   | 90   | 64  | 75   | 69  | 82   |
| 35   | 86                             | 116  | 77  | 103  | 90   | 112  | 77  | 90   | 83  | 98   |
| 50   | 104                            | 140  | 92  | 124  | 110  | 136  | 91  | 106  | 99  | 117  |
| 70   | 133                            | 179  | 116 | 156  | 140  | 174  | 112 | 130  | 122 | 144  |
| 95   | 161                            | 217  | 139 | 188  | 170  | 211  | 132 | 154  | 148 | 172  |
| 120  | 186                            | 251  | 160 | 216  | 197  | 245  | 150 | 174  | 169 | 197  |
| 150  | 204                            | 267  | 176 | 240  | 227  | 283  | 169 | 197  | 189 | 220  |
| 185  | 230                            | 300  | 199 | 272  | 259  | 323  | 190 | 220  | 214 | 250  |
| 240  | 269                            | 351  | 232 | 318  | 305  | 382  | 218 | 253  | 250 | 290  |
| 300  | 306                            | 402  | 265 | 364  | 351  | 440  | 247 | 286  | 282 | 326  |



4.2.4 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – PVC insulation, copper or aluminium conductors

| Nominal cross-sectional area of conductor mm <sup>2</sup> | Multi-core cables     |                         | Single-core cables             |                                 |                               |            |          |
|---|-----------------------|-------------------------|--------------------------------|---------------------------------|-------------------------------|------------|----------|
|   | Two loaded conductors | Three loaded conductors | Two loaded conductors touching | Three loaded conductors trefoil | Three loaded conductors, flat |            |          |
|   |                       |                         |                                |                                 | Touching                      | Spaced     |          |
|   |                       |                         |                                |                                 |                               | Horizontal | Vertical |
|   | method E              | method E                | method F                       | method F                        | method F                      | method G   | method G |
| Cu  |                       |                         |                                |                                 |                               |            |          |
| 1,5   | 22                    | 18,5                    | -                              | -                               | -                             | -          | -        |
| 2,5   | 30                    | 25                      | -                              | -                               | -                             | -          | -        |
| 4   | 40                    | 34                      | -                              | -                               | -                             | -          | -        |
| 6   | 51                    | 43                      | -                              | -                               | -                             | -          | -        |
| 10  | 70                    | 60                      | -                              | -                               | -                             | -          | -        |
| 16  | 94                    | 80                      | -                              | -                               | -                             | -          | -        |
| 25  | 119                   | 101                     | 131                            | 110                             | 114                           | 146        | 130      |
| 35  | 148                   | 126                     | 162                            | 137                             | 143                           | 181        | 162      |
| 50  | 180                   | 153                     | 196                            | 167                             | 174                           | 219        | 197      |
| 70  | 232                   | 196                     | 251                            | 216                             | 225                           | 281        | 254      |
| 95  | 282                   | 238                     | 304                            | 264                             | 275                           | 341        | 311      |
| 120   | 328                   | 276                     | 352                            | 308                             | 321                           | 396        | 362      |
| 150   | 379                   | 319                     | 406                            | 356                             | 372                           | 456        | 419      |
| 185   | 434                   | 364                     | 463                            | 409                             | 427                           | 521        | 480      |
| 240   | 514                   | 430                     | 546                            | 485                             | 507                           | 615        | 569      |
| 300   | 593                   | 497                     | 629                            | 561                             | 587                           | 709        | 659      |
| 400   | -                     | -                       | 754                            | 656                             | 689                           | 852        | 795      |
| 500   | -                     | -                       | 868                            | 749                             | 789                           | 982        | 920      |
| 630   | -                     | -                       | 1005                           | 855                             | 905                           | 1138       | 1070     |
| Al  |                       |                         |                                |                                 |                               |            |          |
| 16  | 73                    | 61                      | -                              | -                               | -                             | -          | -        |
| 25  | 89                    | 78                      | 98                             | 84                              | 87                            | 112        | 99       |
| 35  | 111                   | 96                      | 122                            | 105                             | 109                           | 139        | 124      |
| 50  | 135                   | 117                     | 149                            | 128                             | 133                           | 169        | 152      |
| 70  | 173                   | 150                     | 192                            | 166                             | 173                           | 217        | 196      |
| 95  | 210                   | 183                     | 235                            | 203                             | 212                           | 265        | 241      |
| 120   | 244                   | 212                     | 273                            | 237                             | 247                           | 308        | 282      |
| 150   | 282                   | 245                     | 316                            | 274                             | 287                           | 356        | 327      |
| 185   | 322                   | 280                     | 363                            | 315                             | 330                           | 407        | 376      |
| 240   | 380                   | 330                     | 430                            | 375                             | 392                           | 482        | 447      |
| 300   | 439                   | 381                     | 497                            | 434                             | 455                           | 557        | 519      |
| 400   | -                     | -                       | 600                            | 526                             | 552                           | 671        | 629      |
| 500   | -                     | -                       | 694                            | 610                             | 640                           | 775        | 730      |
| 630   | -                     | -                       | 808                            | 711                             | 746                           | 900        | 852      |



4.2.5 Current-carrying capacities in amperes for methods of installation acc. to IEC 60364-5-52 in table B.52.1 – XLPE insulation, copper or aluminium conductors

| Nominal cross-sectional area of conductor mm <sup>2</sup> | Multi-core cables     |                         | Single-core cables             |                                 |                               |            |          |
|---|-----------------------|-------------------------|--------------------------------|---------------------------------|-------------------------------|------------|----------|
|   | Two loaded conductors | Three loaded conductors | Two loaded conductors touching | Three loaded conductors trefoil | Three loaded conductors, flat |            |          |
|   |                       |                         |                                |                                 | Touching                      | Spaced     |          |
|   |                       |                         |                                |                                 |                               | Horizontal | Vertical |
| method E  | method E              | method F                | method F                       | method F                        | method G                      | method G   |          |
| <b>Cu</b>   |                       |                         |                                |                                 |                               |            |          |
| 1,5   | 26                    | 23                      | -                              | -                               | -                             | -          | -        |
| 2,5   | 36                    | 32                      | -                              | -                               | -                             | -          | -        |
| 4   | 49                    | 42                      | -                              | -                               | -                             | -          | -        |
| 6   | 63                    | 54                      | -                              | -                               | -                             | -          | -        |
| 10  | 86                    | 75                      | -                              | -                               | -                             | -          | -        |
| 16  | 115                   | 100                     | -                              | -                               | -                             | -          | -        |
| 25  | 149                   | 127                     | 161                            | 135                             | 141                           | 182        | 161      |
| 35  | 185                   | 158                     | 200                            | 169                             | 176                           | 226        | 201      |
| 50  | 225                   | 192                     | 242                            | 207                             | 216                           | 275        | 246      |
| 70  | 289                   | 246                     | 310                            | 268                             | 279                           | 353        | 318      |
| 95  | 352                   | 298                     | 377                            | 328                             | 342                           | 430        | 389      |
| 120   | 410                   | 346                     | 437                            | 383                             | 400                           | 500        | 454      |
| 150   | 473                   | 399                     | 504                            | 444                             | 464                           | 577        | 527      |
| 185   | 542                   | 456                     | 575                            | 510                             | 533                           | 661        | 605      |
| 240   | 641                   | 538                     | 679                            | 607                             | 634                           | 781        | 719      |
| 300   | 741                   | 621                     | 783                            | 703                             | 736                           | 902        | 833      |
| 400   | -                     | -                       | 940                            | 823                             | 868                           | 1085       | 1008     |
| 500   | -                     | -                       | 1083                           | 946                             | 998                           | 1253       | 1169     |
| 630   | -                     | -                       | 1254                           | 1088                            | 1151                          | 1454       | 1362     |
| <b>Al</b>   |                       |                         |                                |                                 |                               |            |          |
| 16  | 91                    | 77                      | -                              | -                               | -                             | -          | -        |
| 25  | 108                   | 97                      | 121                            | 103                             | 107                           | 138        | 122      |
| 35  | 135                   | 120                     | 150                            | 129                             | 135                           | 172        | 153      |
| 50  | 164                   | 146                     | 184                            | 159                             | 165                           | 210        | 188      |
| 70  | 211                   | 187                     | 237                            | 206                             | 215                           | 271        | 244      |
| 95  | 257                   | 227                     | 289                            | 253                             | 264                           | 332        | 300      |
| 120   | 300                   | 263                     | 337                            | 296                             | 308                           | 387        | 351      |
| 150   | 346                   | 304                     | 389                            | 343                             | 358                           | 448        | 408      |
| 185   | 397                   | 347                     | 447                            | 395                             | 413                           | 515        | 470      |
| 240   | 470                   | 409                     | 530                            | 471                             | 492                           | 611        | 561      |
| 300   | 543                   | 471                     | 613                            | 547                             | 571                           | 708        | 652      |
| 400   | -                     | -                       | 740                            | 663                             | 694                           | 856        | 792      |
| 500   | -                     | -                       | 856                            | 770                             | 806                           | 991        | 921      |
| 630   | -                     | -                       | 996                            | 899                             | 942                           | 1154       | 1077     |



### 4.3 Correction factors for specific installation conditions

For conditions different from the base conditions see 4.1, appropriate correction factors shall be applied.

If more than one correction factor is applicable, the factors have to be multiplied to determine the total applicable rating factor.

#### 4.3.1 Correction factors for ambient air temperature other than 30 °C (IEC table B.52.14)

| Ambient air temperature<br>°C | Insulation type |      |
|-------------------------------|-----------------|------|
|                               | PVC             | XLPE |
| 10                            | 1,22            | 1,15 |
| 15                            | 1,17            | 1,12 |
| 20                            | 1,12            | 1,08 |
| 25                            | 1,06            | 1,04 |
| 30                            | 1,00            | 1,00 |
| 35                            | 0,94            | 0,96 |
| 40                            | 0,87            | 0,91 |
| 45                            | 0,79            | 0,87 |
| 50                            | 0,71            | 0,82 |
| 55                            | 0,61            | 0,76 |
| 60                            | 0,50            | 0,71 |
| 65                            | -               | 0,65 |
| 70                            | -               | 0,58 |
| 75                            | -               | 0,50 |
| 80                            | -               | 0,41 |

#### 4.3.2 Correction factors for ambient ground temperature other than 20 °C (IEC table B.52.15)

| Ambient ground temperature<br>°C | Insulation type |      |
|----------------------------------|-----------------|------|
|                                  | PVC             | XLPE |
| 10                               | 1,10            | 1,07 |
| 15                               | 1,05            | 1,04 |
| 20                               | 1,00            | 1,00 |
| 25                               | 0,95            | 0,96 |
| 30                               | 0,89            | 0,93 |
| 35                               | 0,84            | 0,89 |
| 40                               | 0,77            | 0,85 |
| 45                               | 0,71            | 0,80 |
| 50                               | 0,63            | 0,76 |
| 55                               | 0,55            | 0,71 |
| 60                               | 0,45            | 0,65 |
| 65                               | -               | 0,60 |
| 70                               | -               | 0,53 |
| 75                               | -               | 0,46 |
| 80                               | -               | 0,38 |

### 4.3.3 Correction factors for soil thermal resistivity other than 2,5 K·m/W (IEC table B.52.16)

| Thermal resistivity (K·m/W)           | 0,5  | 0,7  | 1    | 1,5  | 2    | 2,5 | 3    |
|---------------------------------------|------|------|------|------|------|-----|------|
| Cables in buried ducts <sup>(*)</sup> | 1,28 | 1,20 | 1,18 | 1,1  | 1,05 | 1   | 0,96 |
| Cables direct buried                  | 1,88 | 1,62 | 1,5  | 1,28 | 1,12 | 1   | 0,90 |

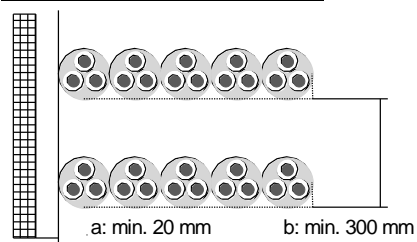



<sup>(\*)</sup> applicable up to 0,8 m buried depths.

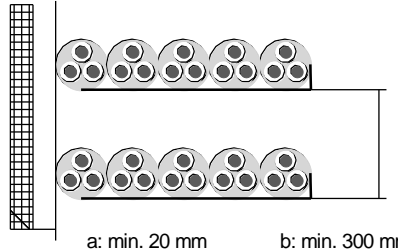
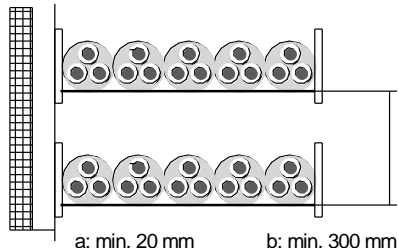
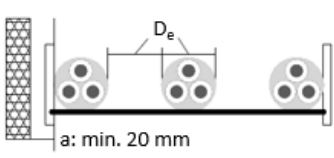
## 4.4 Reduction factors

### 4.4.1 Reduction factors for more than one multi-core cable or system of single-core cables laid according to method C (IEC table B.52.17 item 2)

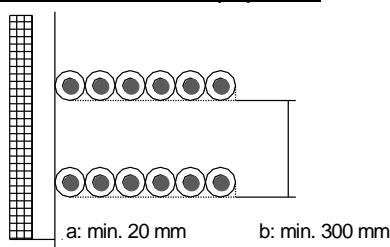

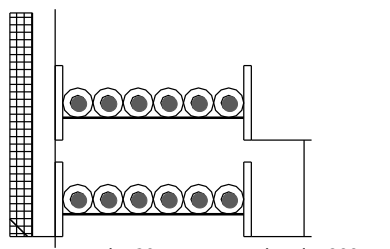
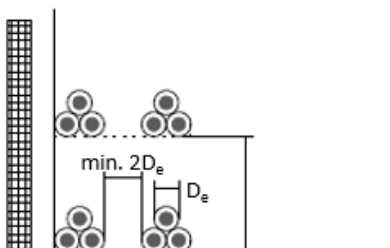
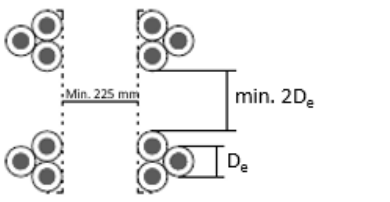
| Number of circuits or multi-core cables |      |      |      |      |      |      |      |      |
|---|------|------|------|------|------|------|------|------|
| 1                                       | 2    | 3    | 4    | 5    | 6    | 7    | 8    | 9    |
| 1,00                                    | 0,85 | 0,79 | 0,75 | 0,73 | 0,72 | 0,72 | 0,71 | 0,70 |

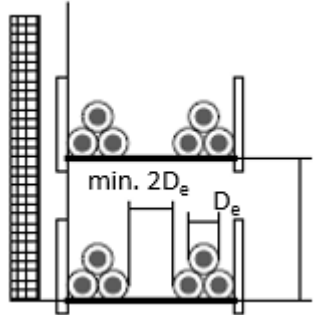
### 4.4.2 Reduction factors for more than one multi-core cable laid according to method E (IEC table B.52.20)

| Method of installation   | Nr. of trays | Number of cables per tray |      |      |      |      |      |
|--|--------------|---------------------------|------|------|------|------|------|
|  |              | 1                         | 2    | 3    | 4    | 6    | 9    |
| <b>Perforated cable tray systems</b><br><br>a: min. 20 mm      b: min. 300 mm<br>a: distance between tray and wall<br>b: distance between trays | 1            | 1,00                      | 0,88 | 0,82 | 0,79 | 0,76 | 0,73 |
|  | 2            | 1,00                      | 0,87 | 0,80 | 0,77 | 0,73 | 0,68 |
|  | 3            | 1,00                      | 0,86 | 0,79 | 0,76 | 0,71 | 0,66 |
|  | 6            | 1,00                      | 0,84 | 0,77 | 0,73 | 0,68 | 0,64 |
| <br>a: min. 20 mm   | 1            | 1,00                      | 1,00 | 0,98 | 0,95 | 0,91 | -    |
|  | 2            | 1,00                      | 0,99 | 0,96 | 0,92 | 0,87 | -    |
|  | 3            | 1,00                      | 0,98 | 0,95 | 0,91 | 0,85 | -    |
| <br>Min. 225 mm   | 1            | 1,00                      | 0,88 | 0,82 | 0,78 | 0,73 | 0,72 |
|  | 2            | 1,00                      | 0,88 | 0,81 | 0,76 | 0,71 | 0,70 |
| <br>Min. 225 mm      D <sub>e</sub>   | 1            | 1,00                      | 0,91 | 0,89 | 0,88 | 0,87 | -    |
|  | 2            | 1,00                      | 0,91 | 0,88 | 0,87 | 0,85 | -    |

| Method of installation   | Nr. of trays | Number of cables per tray |      |      |      |      |      |
|--|--------------|---------------------------|------|------|------|------|------|
|  |              | 1                         | 2    | 3    | 4    | 6    | 9    |
| <u>Unperforated cable tray systems</u><br><br>a: min. 20 mm      b: min. 300 mm<br>a: distance between tray and wall<br>b: distance between trays | 1            | 0,97                      | 0,84 | 0,78 | 0,75 | 0,71 | 0,68 |
|  | 2            | 0,97                      | 0,83 | 0,76 | 0,72 | 0,68 | 0,63 |
|  | 3            | 0,97                      | 0,82 | 0,75 | 0,71 | 0,66 | 0,61 |
|  | 6            | 0,97                      | 0,81 | 0,73 | 0,69 | 0,63 | 0,58 |
| <u>Cable ladder systems</u><br><br>a: min. 20 mm      b: min. 300 mm<br>a: distance between ladder and wall<br>b: distance between ladders        | 1            | 1,00                      | 0,87 | 0,82 | 0,80 | 0,79 | 0,78 |
|  | 2            | 1,00                      | 0,86 | 0,80 | 0,78 | 0,76 | 0,73 |
|  | 3            | 1,00                      | 0,85 | 0,79 | 0,76 | 0,73 | 0,70 |
|  | 6            | 1,00                      | 0,84 | 0,77 | 0,73 | 0,68 | 0,64 |
| <br>a: min. 20 mm   | 1            | 1,00                      | 1,00 | 1,00 | 1,00 | 1,00 | -    |
|  | 2            | 1,00                      | 0,99 | 0,98 | 0,97 | 0,96 | -    |
|  | 3            | 1,00                      | 0,98 | 0,97 | 0,96 | 0,93 | -    |
| General Note: Factors apply to single layer groups of cables as shown above and do not apply when cables are installed in more than one layer touching each other.   |              |                           |      |      |      |      |      |

#### 4.4.3 Reduction factors for groups of one or more circuits of single-core cable laid according to method F (IEC table B.52.21)

| Method of installation   | Nr. of trays | Number of three-phase circuits per tray or ladder |      |      | Use as a multiplier to current carrying capacity for |
|--|--------------|---|------|------|--|
|  |              | 1   | 2    | 3    |  |
| <u>Perforated cable tray systems</u><br><br>a: min. 20 mm      b: min. 300 mm<br>a: distance between tray and wall<br>b: distance between trays       | 1            | 0,98  | 0,91 | 0,87 | Three cables in horizontal formation                 |
|  | 2            | 0,96  | 0,87 | 0,81 |  |
|  | 3            | 0,95  | 0,85 | 0,78 |  |
| <br>Min. 225 mm  | 1            | 0,96  | 0,86 | -    | Three cables in vertical formation                   |
|  | 2            | 0,95  | 0,84 | -    |  |
| <u>Cable ladder systems</u><br><br>a: min. 20 mm      b: min. 300 mm<br>a: distance between ladder and wall<br>b: distance between ladders          | 1            | 1,00  | 0,97 | 0,96 | Three cables in horizontal formation                 |
|  | 2            | 0,98  | 0,93 | 0,89 |  |
|  | 3            | 0,97  | 0,90 | 0,86 |  |
| <u>Perforated cable tray systems</u><br><br>a: min. 20 mm      b: min. 300 mm<br>a: distance between ladder and wall<br>b: distance between ladders | 1            | 1,00  | 0,98 | 0,96 | Three cables in trefoil formation                    |
|  | 2            | 0,97  | 0,93 | 0,89 |  |
|  | 3            | 0,96  | 0,92 | 0,86 |  |
| <br>Min. 225 mm      min. 2D <sub>e</sub><br>D <sub>e</sub>   | 1            | 1,00  | 0,91 | 0,89 | Three cables in trefoil formation                    |
|  | 2            | 1,00  | 0,90 | 0,86 |  |

| Method of installation  | Nr. of trays | Number of three-phase circuits per tray or ladder |      |      | Use as a multiplier to current carrying capacity for |
|---|--------------|---|------|------|--|
|   |              | 1   | 2    | 3    |  |
| Cable ladder systems<br><br>a: min. 20 mm b: min. 300 mm<br>a: distance between ladder and wall<br>b: distance between ladders   | 1            | 1,00  | 1,00 | 1,00 | Three cables in trefoil formation                    |
|   | 2            | 0,97  | 0,95 | 0,93 |  |
|   | 3            | 0,96  | 0,94 | 0,90 |  |
| General Note: Factors are given for single layers of cables (or trefoil groups) as shown in the tables and do not apply when cables are installed in more one layer touching each other.<br>If a circuit consists of $m$ parallel conductors per phase, then for determining the reduction factors this circuit should be considered as $m$ circuits. |              |   |      |      |  |

#### 4.4.4 Reduction factors for groups of one or more circuits of single-core cable laid according to method G

No correction factors are given in the IEC standard for this laying method.


#### 4.4.5 Reduction factors for more than one multi-core cable or system of single-core cables laid according to method B1 (IEC table B.52.17 item 1)

| Number of circuits or multi-core cables |      |      |      |      |      |      |      |      |      |      |      |
|---|------|------|------|------|------|------|------|------|------|------|------|
| 1                                       | 2    | 3    | 4    | 5    | 6    | 7    | 8    | 9    | 12   | 16   | 20   |
| 1,00                                    | 0,80 | 0,70 | 0,65 | 0,60 | 0,57 | 0,54 | 0,52 | 0,50 | 0,45 | 0,41 | 0,38 |



4.4.6 Reduction factors for more than one circuit of cables laid in ducts in the ground according to method D1 (IEC table B.52.19 A)

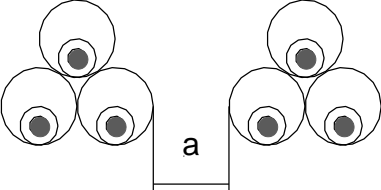
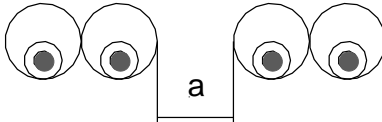
| A) Multi-core cables in single-way ducts |                             |        |       |       |
|--|-----------------------------|--------|-------|-------|
| Number of ducts                          | Duct to duct clearance (=a) |        |       |       |
|  | Ducts touching              | 0,25 m | 0,5 m | 1,0 m |
| 2  | 0,85                        | 0,90   | 0,95  | 0,95  |
| 3  | 0,75                        | 0,85   | 0,90  | 0,95  |
| 4  | 0,70                        | 0,80   | 0,85  | 0,90  |
| 5  | 0,65                        | 0,80   | 0,85  | 0,90  |
| 6  | 0,60                        | 0,80   | 0,80  | 0,90  |
| 7  | 0,57                        | 0,76   | 0,80  | 0,88  |
| 8  | 0,54                        | 0,74   | 0,78  | 0,88  |
| 9  | 0,52                        | 0,73   | 0,77  | 0,87  |
| 10                                       | 0,49                        | 0,72   | 0,76  | 0,86  |
| 11                                       | 0,47                        | 0,70   | 0,75  | 0,86  |
| 12                                       | 0,45                        | 0,69   | 0,74  | 0,85  |
| 13                                       | 0,44                        | 0,68   | 0,73  | 0,85  |
| 14                                       | 0,42                        | 0,68   | 0,72  | 0,84  |
| 15                                       | 0,41                        | 0,67   | 0,72  | 0,84  |
| 16                                       | 0,39                        | 0,66   | 0,71  | 0,83  |
| 17                                       | 0,38                        | 0,65   | 0,70  | 0,83  |
| 18                                       | 0,37                        | 0,65   | 0,70  | 0,83  |
| 19                                       | 0,35                        | 0,64   | 0,69  | 0,82  |
| 20                                       | 0,34                        | 0,63   | 0,68  | 0,82  |



4.4.7 Reduction factors for more than one circuit of cables laid in ducts in the ground according to method D1 (IEC table B.52.19 B)

| B) single-core cables in non-magnetic single-way ducts |                             |        |       |       |
|--|-----------------------------|--------|-------|-------|
| Number of ducts  | Duct to duct clearance (=a) |        |       |       |
|  | Ducts touching              | 0,25 m | 0,5 m | 1,0 m |
| 2  | 0,80                        | 0,90   | 0,90  | 0,95  |
| 3  | 0,70                        | 0,80   | 0,85  | 0,90  |
| 4  | 0,65                        | 0,75   | 0,80  | 0,90  |
| 5  | 0,60                        | 0,70   | 0,80  | 0,90  |
| 6  | 0,60                        | 0,70   | 0,80  | 0,90  |
| 7  | 0,53                        | 0,66   | 0,76  | 0,87  |
| 8  | 0,50                        | 0,63   | 0,74  | 0,87  |
| 9  | 0,47                        | 0,61   | 0,73  | 0,86  |
| 10   | 0,45                        | 0,59   | 0,72  | 0,85  |
| 11   | 0,43                        | 0,57   | 0,70  | 0,85  |
| 12   | 0,41                        | 0,56   | 0,69  | 0,84  |
| 13   | 0,39                        | 0,54   | 0,68  | 0,84  |
| 14   | 0,37                        | 0,53   | 0,68  | 0,83  |
| 15   | 0,35                        | 0,52   | 0,67  | 0,83  |
| 16   | 0,34                        | 0,51   | 0,66  | 0,83  |
| 17   | 0,33                        | 0,50   | 0,65  | 0,82  |
| 18   | 0,31                        | 0,49   | 0,65  | 0,82  |
| 19   | 0,30                        | 0,48   | 0,64  | 0,82  |
| 20   | 0,29                        | 0,47   | 0,63  | 0,81  |


  

If a circuit consists of  $m$  parallel conductors per phase, then for determining the reduction factors this circuit should be considered as  $m$  circuits.

#### 4.4.8 Reduction factors for more than one circuit of cables laid directly in the ground according to method D2 (IEC table B.52.18)

| Number of circuits | Cable to cable clearance (=a) |                        |         |        |       |
|--------------------|-------------------------------|------------------------|---------|--------|-------|
|                    | cables touching               | one cable- $\emptyset$ | 0,125 m | 0,25 m | 0,5 m |
| 2                  | 0,75                          | 0,80                   | 0,85    | 0,90   | 0,90  |
| 3                  | 0,65                          | 0,70                   | 0,75    | 0,80   | 0,85  |
| 4                  | 0,60                          | 0,60                   | 0,70    | 0,75   | 0,80  |
| 5                  | 0,55                          | 0,55                   | 0,65    | 0,70   | 0,80  |
| 6                  | 0,50                          | 0,55                   | 0,60    | 0,70   | 0,80  |
| 7                  | 0,45                          | 0,51                   | 0,59    | 0,67   | 0,76  |
| 8                  | 0,43                          | 0,48                   | 0,57    | 0,65   | 0,75  |
| 9                  | 0,41                          | 0,46                   | 0,55    | 0,63   | 0,74  |
| 12                 | 0,36                          | 0,42                   | 0,51    | 0,59   | 0,71  |
| 16                 | 0,32                          | 0,38                   | 0,47    | 0,56   | 0,68  |
| 20                 | 0,29                          | 0,35                   | 0,44    | 0,53   | 0,66  |



If a circuit consists of  $m$  parallel conductors per phase, then for determining the reduction factors this circuit should be considered as  $m$  circuits.

#### 4.4.9 Reduction factors for single core cables with Al-armor

Reduction factor for cables with Al tape armour:

$\leq 300 \text{ mm}^2$  cross-section: N.A.

$> 300 \text{ mm}^2$  cross-section: 0,96

Reduction factor for cables with Al wire armour:

$\leq 300 \text{ mm}^2$  cross-section: 0,95

$> 300 \text{ mm}^2$  cross-section: 0,90

This factors are only applicable for cables laid in trefoil. For flat laid systems, special derating factors are available on request.

#### 4.4.10 Derating factors for control cables with $> 3$ cores on load

| Number of loaded cores | Laid in air | Laid in ground |
|------------------------|-------------|----------------|
| 5                      | 0,75        | 0,70           |
| 7                      | 0,65        | 0,60           |
| 10                     | 0,55        | 0,50           |
| 14                     | 0,50        | 0,45           |
| 19                     | 0,45        | 0,40           |
| 24                     | 0,40        | 0,35           |
| 40                     | 0,35        | 0,30           |
| 61                     | 0,30        | 0,25           |

For deviating numbers of cores, the next higher value shall be used.



## 5. Thermic short circuit current rating

The following information concerns only the adiabatic thermic effect of a short circuit.  
The mechanical effects (peak short circuit) can be calculated on demand for specific cable types.

The permissible short circuit current depends on the following parameters:

S = nominal cross-section of the relevant cable construction element (conductor, screen, armour...)  
(mm<sup>2</sup>)

t = time of short circuit (max. 5 sec for adiabatic heating effect) (sec)

k = specific value depending on the relevant material and the applicable temperature limits  
(A · √sec / mm<sup>2</sup>)

I<sub>cc</sub> = short circuit current (A)

$$I_{cc} = \frac{S \cdot k}{\sqrt{t}} \quad S = \frac{I_{cc} \cdot \sqrt{t}}{k}$$

For the insulated phase conductors (conductor made of bare Cu and Al)

|   |                  |       |
|---|------------------|-------|
| Conductor temperature before short circuit: | XLPE insulation: | 90 °C |
|   | PVC insulation:  | 70 °C |

|                                    |  |        |
|------------------------------------|--|--------|
| Maximum short circuit temperature: | XLPE insulation:                       | 250 °C |
|                                    | PVC Insulation ≤ 300 mm <sup>2</sup> : | 160 °C |
|                                    | PVC insulation > 300 mm <sup>2</sup> : | 140 °C |

|     |  |                                |
|-----|--|--------------------------------|
| k : | Copper conductors XLPE insulated:                      | 143 A · √sec / mm <sup>2</sup> |
|     | Copper conductor PVC insulated ≤ 300 mm <sup>2</sup> : | 115 A · √sec / mm <sup>2</sup> |
|     | Copper conductor PVC insulated > 300 mm <sup>2</sup> : | 103 A · √sec / mm <sup>2</sup> |

|   |                               |
|---|-------------------------------|
| Aluminium conductor XLPE insulated:                       | 94 A · √sec / mm <sup>2</sup> |
| Aluminium conductor PVC insulated ≤ 300 mm <sup>2</sup> : | 76 A · √sec / mm <sup>2</sup> |
| Aluminium conductor PVC insulated > 300 mm <sup>2</sup> : | 68 A · √sec / mm <sup>2</sup> |

t : For short circuit times **t ≠ 1 sec** (max. 5 sec) use the rating factor  $1/\sqrt{t}$

| Icc (kA) for 1 sec   |                 |       |              |
|--|-----------------|-------|--------------|
| Nominal cross-sectional area of conductor<br><br>mm <sup>2</sup> | Cu conductor    |       | Al conductor |
|  | Insulation type |       |              |
|  | PVC             | XLPE  | XLPE         |
| 1,5  | 0,173           | 0,215 | -            |
| 2,5  | 0,288           | 0,358 | -            |
| 4  | 0,460           | 0,572 | -            |
| 6  | 0,690           | 0,858 | -            |
| 10   | 1,15            | 1,43  | -            |
| 16   | 1,84            | 2,29  | 1,50         |
| 25   | 2,88            | 3,58  | 2,35         |
| 35   | 4,03            | 5,01  | 3,29         |
| 50   | 5,75            | 7,15  | 4,70         |
| 70   | 8,05            | 10,0  | 6,58         |
| 95   | 10,9            | 13,6  | 8,93         |
| 120  | 13,8            | 17,2  | 11,3         |
| 150  | 17,3            | 21,5  | 14,1         |
| 185  | 21,3            | 26,5  | 17,4         |
| 240  | 27,6            | 34,3  | 22,6         |
| 300  | 34,5            | 42,9  | 28,2         |
| 400  | 41,2            | 57,2  | 37,6         |
| 500  | 51,5            | 71,5  | 47,0         |
| 630  | 64,9            | 90,1  | 59,2         |



## 6. Admissible pulling forces P(N)

### a) with pulling head

$P = A \cdot 50 \text{ N/mm}^2$  for copper cables

$P = A \cdot 30 \text{ N/mm}^2$  for aluminium cables

### b) with cable stocking

**Force acting on the conductors (without armour):**

See a)

**Force acting on the outer sheath (without armour or with steel tapes armour):**

$P = D_e^2 \cdot 3 \text{ N/mm}^2$  (with max. see a))

**Force acting on a steel wire armour (round or flat wires)**

$P = D_e^2 \cdot 9 \text{ N/mm}^2$

A=Size of all conductors in  $\text{mm}^2$  (without screen)

$D_e$ =Cable diameter (mm)

## 7. Disclaimer

All information given is indicative only and not binding and can be subject to change without notice.



www.eupen.com



Kabelwerk  
**EUPEN** AG



Malmedyer Str. 9 - 4700 EUPEN - BELGIUM

Tel.: +32(0)87 59 70 00

e-mail: info@eupen.com

<http://www.eupen.com>

ISO Certified Company